


## H6HK Series Electric Heater Kit

### INSTALLATION INSTRUCTIONS

#### Installation in Standard & Variable Speed Indoor Air Handlers

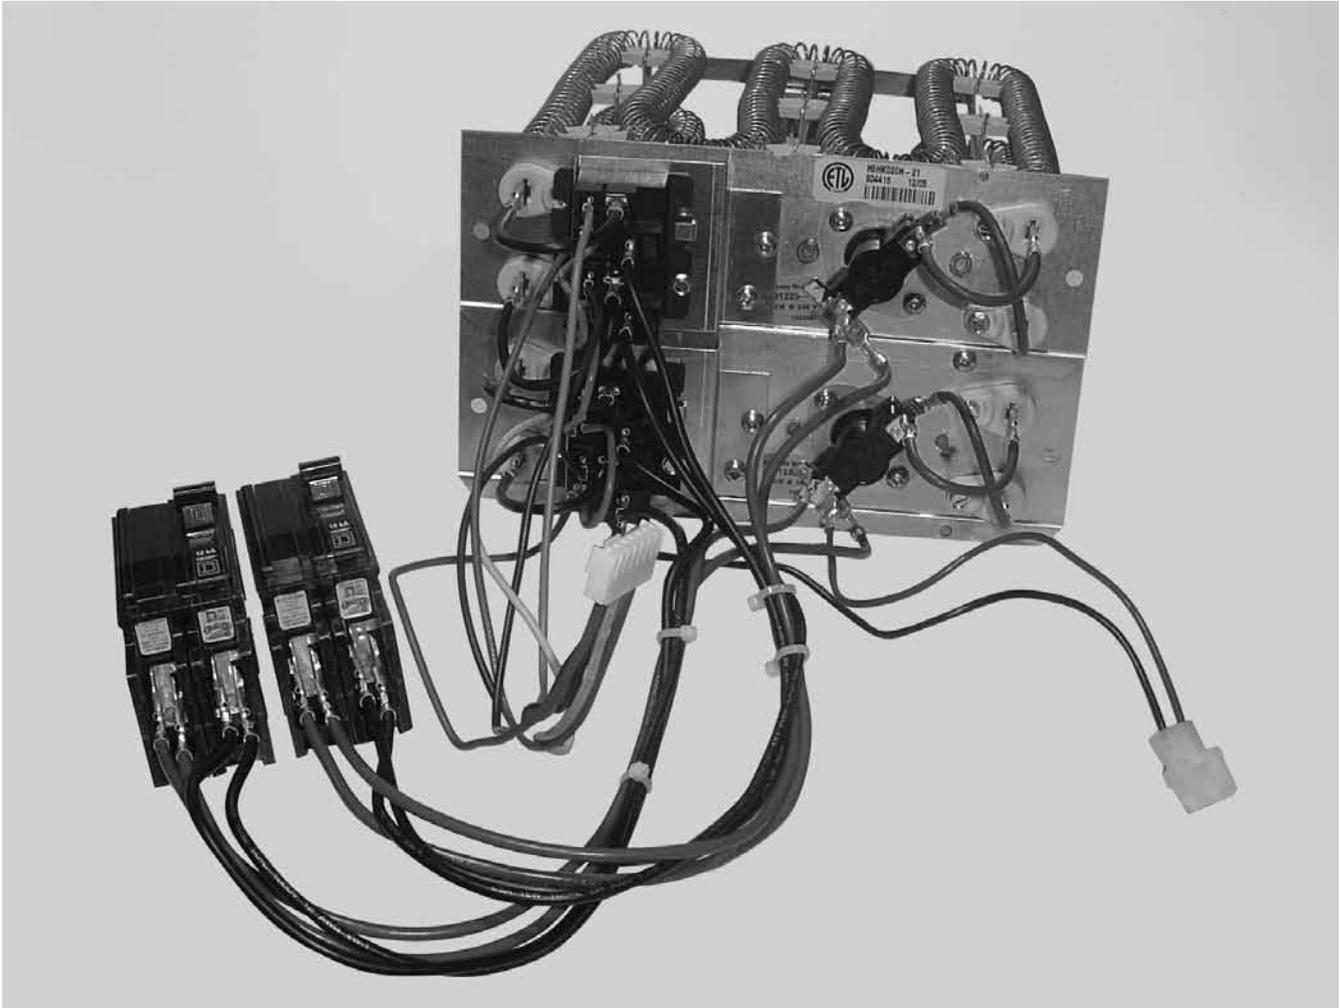

### IMPORTANT

These instructions are primarily intended to assist qualified individuals experienced in the proper installation of heating and/or air conditioning appliances. Some local codes require licensed installation/service personnel for this type equipment. All installations must be in accordance with these instructions and with all applicable national and local codes and standards.

Read these instructions thoroughly before starting the installation. Follow all precautions and warnings contained within these instructions and on the unit. The instructions included with this heater kit are for installations in air handlers only.

**DO NOT DESTROY. PLEASE READ CAREFULLY &  
KEEP IN A SAFE PLACE FOR FUTURE REFERENCE.**

## TABLE OF CONTENTS

<b>IMPORTANT SAFETY INFORMATION .....</b>	<b>2</b>
<b>GENERAL INFORMATION .....</b>	<b>2</b>
About the Heater Kit.....	2
Clearances to Combustibles.....	3
Standard Air Handlers.....	3
Variable Speed Air Handlers.....	3
Electrical Supply.....	3
<b>HEATER KIT INSTALLATION.....</b>	<b>3</b>
E Element Assembly Installation.....	4
Electric Heater Kits with Circuit Breakers.....	5
5, 8, & 10 kw Electric Heater Kits .....	5
15, 20, 25, & 30 kw Electric Heater Kits .....	5
3-Phase 9 & 15 kw electric heater kits.....	5
Line Cover.....	5
Electric Heater Kits without Circuit Breakers.....	5
Power Wiring .....	6
Staging .....	6
<b>MOTOR SPEED SELECTION.....</b>	<b>6</b>
Standard Air Handlers.....	6
Variable Speed Air Handlers .....	7
<b>WIRING DIAGRAMS.....</b>	<b>8</b>
Figure 7 - Single Ph. - 5Kw Series .....	8
Figure 8 - Single Ph. - 8 & 10kW Series .....	8
Figure 9 - Single Ph. - 15kW Series .....	9
Figure 10 - Single Ph. 20kW Series.....	9
Figure 11 - Single Ph. 24kW Series.....	10
Figure 12 - Single Ph. 25kW Series.....	11
Figure 13 - Single Ph. 29kW Series.....	12
Figure 14 - Single Ph. 30kW Series.....	13
Figure 15 - Three Phase. - 9 & 15kW Series .....	14

## IMPORTANT SAFETY INFORMATION

INSTALLER: Please read all instructions before servicing this equipment. Pay attention to all safety warnings and any other special notes highlighted in the manual. Safety markings are used frequently throughout this manual to designate a degree or level of seriousness and should not be ignored. **WARNING** indicates a potentially hazardous situation that if not avoided, could result in personal injury or death. **CAUTION** indicates a potentially hazardous situation that if not avoided, may result in minor or moderate injury or property damage.

### **WARNING:**

#### **ELECTRICAL SHOCK, FIRE OR EXPLOSION HAZARD**

**Failure to follow safety warnings exactly could result in serious injury or property damage.**

**Improper servicing could result in dangerous operation, serious injury, death or property damage.**

- **Before servicing, disconnect all electrical power to air handler.**
- **When servicing controls, label all wires prior to disconnecting. Reconnect wires correctly.**
- **Verify proper operation after servicing.**

## GENERAL INFORMATION

### About the heater kit

H6HK Series electric heater kit is approved for field installation in B5, B6, MB7, HMG, HMB, & HCG, air handlers. All sizes are available with factory-provided circuit-breakers for short circuit protection and to provide a disconnecting means. Also available are 5, 8, and 10 kw electric heater kits without circuit-breakers. Refer to the National Electric Code (ANSI/NFPA 70) and applicable local codes for over-current protection and disconnect requirements.

### NOTES:

- The 20, 24/25, and 29/30 kw electric heater kits are NOT approved for installation in A-cabinet air handlers. The 25Kw & 30Kw kits are for B5 C-cabinet air handlers. The 24 & 29 Kw kits are for B6, MB7, HMG, HMB, & HCG C-cabinet air handlers. Use the model identification code (Figure 1, page 2) and

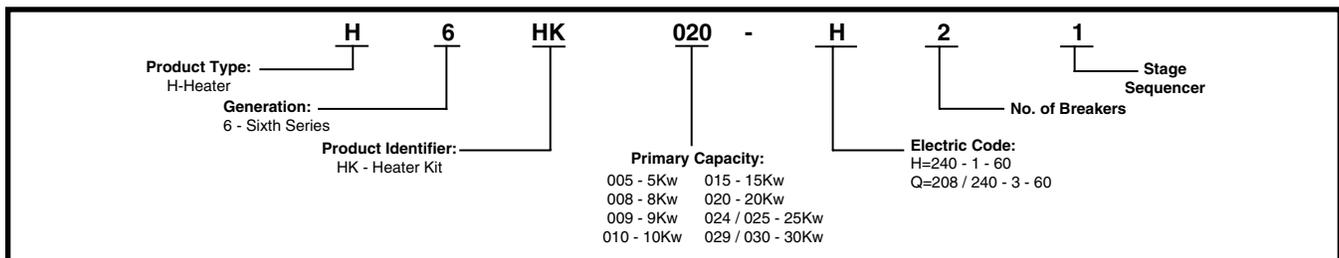


Figure 1. Heater Kit Identification Code

Tables 2 - 4 (page 7) for all Heater Kit applications.

- These instructions are written assuming the air handler is in the upflow position (outlet facing up). For horizontal and downflow applications, it is recommended that the electric heater kit be installed prior to installation of the air handler.
- Use caution when handling or installing this component. Personal injury can occur from sharp metal edges present in all sheet metal constructed equipment.

### Clearances to Combustibles

#### Standard Air Handlers

All electric heater kits less than 20 kw are approved for use in air handler installations with zero-clearance to combustibles at any blower speed. Horizontal and upflow configuration air handlers equipped with 20, 24/25, and 29/30 kw electric heater kits are approved for installation with zero clearance to combustibles at any blower speed. When using a 20, 24/25 kw electric heat kit in a downflow installation, the blower must be set at high speed for both heating and cooling.

#### Variable Speed Air Handlers

All installations of H6HK electric heater kits in variable speed air handlers are approved for zero-clearance to combustibles when the minimum electric heat airflow is set as directed in these instructions.

### Electrical Supply

---

## **WARNING:**

---

**To avoid the risk of electric shock, personal injury, or death, disconnect all electrical power to the unit before performing any maintenance or service. The unit may have more than one electrical power supply.**

---

- All electrical connections must be in compliance with all applicable local codes with the current revision of the National Electric Code (ANSI/NFPA 70). For Canadian installations the electrical connections and grounding shall comply with the current Canadian Electrical Code (CSA C22.1 and/or local codes).
- If the air handler was previously installed without electric heat, the existing supply wiring may not be sufficient to carry the increased load. If installing electric heat in the air handler, the supply wiring can be aluminum or copper. The supplied circuit breakers and terminal blocks are approved for either wire type. Make sure to follow all of the rating information on the circuit breaker or terminal block and that the supply wiring is sized according to the current NEC codes and any other state or local codes. See the rating label or Table 1 (page 4) for minimum circuit ampacities and maximum overcurrent protection.
- All electric heater kits 10 kw or less are supplied from the factory configured for use with a single

supply circuit. Electric heater kits greater than 10 kw are supplied from the factory configured for use with two supply circuits. If a single supply is desired, accessory kit #913874 is required to convert to single circuit connection.

## HEATER KIT INSTALLATION

---

### **WARNING:**

---

#### **ELECTRICAL SHOCK, FIRE OR EXPLOSION HAZARD**

**Failure to follow safety warnings exactly could result in serious injury or property damage.**

**Improper servicing could result in dangerous operation, serious injury, death or property damage.**

- **Before servicing, disconnect all electrical power to air handler.**
  - **When servicing controls, label all wires prior to disconnecting. Reconnect wires correctly.**
  - **Verify proper operation after servicing.**
- 

#### Element Assembly Installation

1. Set the thermostat to the lowest temperature setting.
2. Turn off all electrical power to the air handler.
3. Remove the upper access door from the air handler.
4. Remove the screws securing the upper element close-off plate from the back of the air handler control box.
5. Remove the element close-off plate and set the screws aside. Do not discard the screws. **NOTE:** For 2-tiered electric heater kits, remove two close-off plates. For 3-tiered electric heater kits remove all 3 close-off plates.
6. Insert the element assembly into the opening in the air handler control box being careful not to damage the element wire or the ceramic element supports. **NOTE:** Heating element alignment rods will slide into alignment holes in the back of the air handler element box.
7. Secure the element assembly to the back of the air handler control box with the screws removed in step 4.

**For 25 kw & 30 kw Heater Kits:** Attach the auxiliary circuit board bracket to the lower right side of the installed heater kit assembly with two screws removed in step 4 and snap on the Auxiliary circuit board. **NOTE:** On some units, a shipping bracket may need to be removed before installing the circuit breaker bracket.

8. Connect the 2-Pin Power plug from the element assembly into the unit's 2-Pin power plug. Connect the 7-Pin Harness from the element assembly to the unit's circuit board.

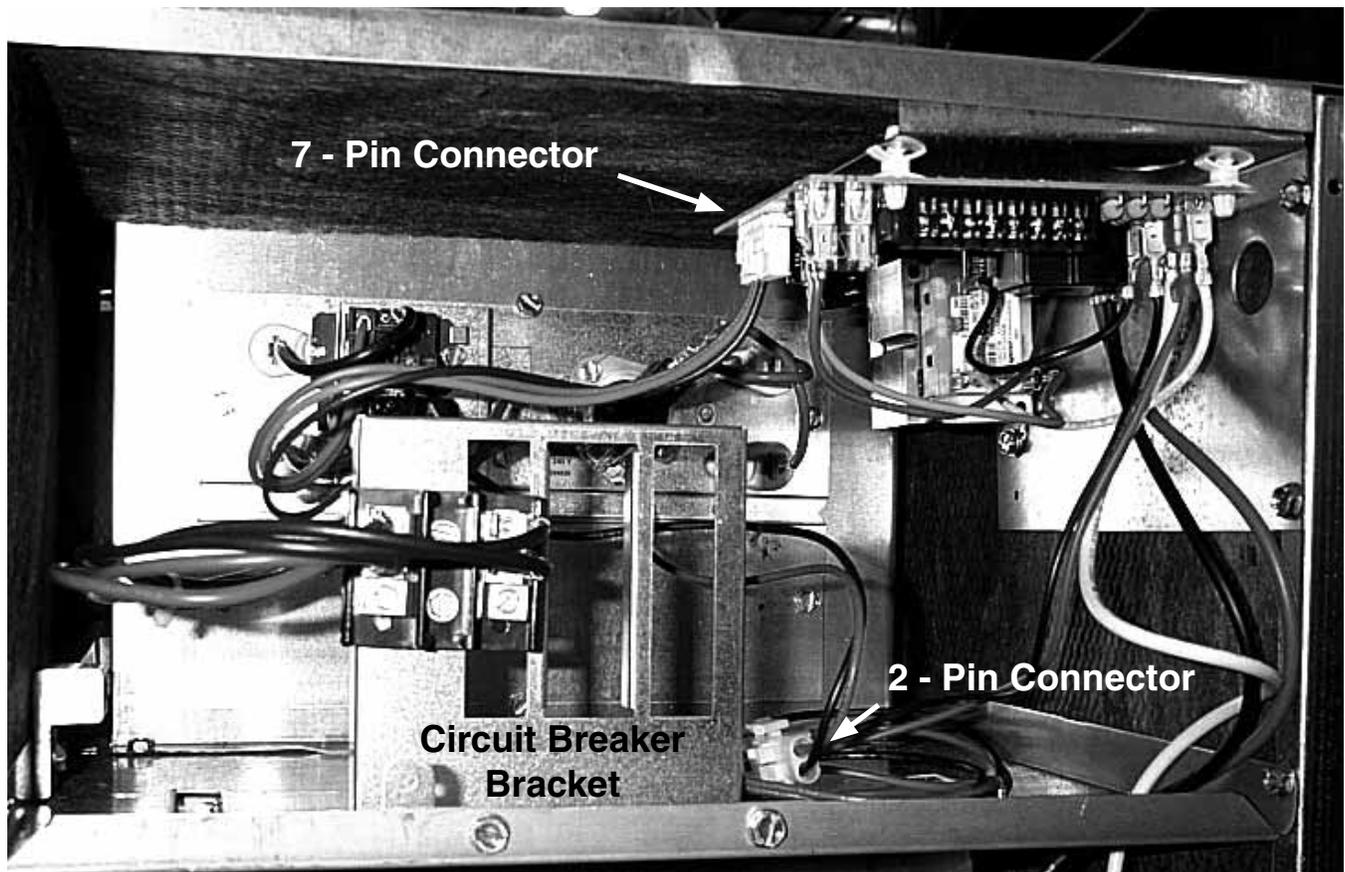


Figure 2. Sample Installation (shown with access door removed)

Model Number	Voltage	Kw	Standard Air Handler (A & B Size)								Variable Speed & Standard Air Handler (C Size)							
			Minimum Circuit Ampacity				Max. Over-Current Circuit Ampacity				Minimum Circuit Ampacity				Max. Over-Current Circuit Ampacity			
			Circuit A	Circuit B	Circuit C	Single Circuit	Circuit A	Circuit B	Circuit C	Single Circuit	Circuit A	Circuit B	Circuit C	Single Circuit	Circuit A	Circuit B	Circuit C	Single Circuit
005H-XX	240	4.8	-	-	-	30	-	-	-	30	-	-	-	34	-	-	-	40
008H-XX	240	7.5	-	-	-	45	-	-	-	50	-	-	-	48	-	-	-	50
010H-XX	240	9.6	-	-	-	55	-	-	-	60	-	-	-	59	-	-	-	60
015H-XX	240	14.4	55	25	-	80	60	30	-	90	59	25	-	83	60	30	-	90
020H-XX	240	19.2	55	50	-	105	60	60	-	125	59	50	-	109	60	60	-	125
025H-XX	240	24.0	-	-	-	-	-	-	-	-	59	50	25	134	60	60	30	150
030H-XX	240	28.8	-	-	-	-	-	-	-	-	59	50	50	159	60	60	60	175
005H-XX	208	3.6	-	-	-	27	-	-	-	30	-	-	-	30	-	-	-	40
008H-XX	208	5.6	-	-	-	39	-	-	-	40	-	-	-	42	-	-	-	50
010H-XX	208	7.2	-	-	-	48	-	-	-	50	-	-	-	52	-	-	-	60
015H-XX	208	10.8	48	21	-	70	50	25	-	80	52	22	-	73	60	25	-	80
020H-XX	208	14.4	48	43	-	92	50	50	-	100	52	43	-	95	60	50	-	100
025H-XX	208	18.0	-	-	-	-	-	-	-	-	52	43	22	117	60	50	25	125
030H-XX	208	21.6	-	-	-	-	-	-	-	-	52	43	43	138	60	50	50	150
009Q-XX	240	9.0	-	-	-	32	-	-	-	40	-	-	-	36	-	-	-	40
015Q-XX	240	14.4	-	-	-	48	-	-	-	50	-	-	-	52	-	-	-	60
009Q-XX	208	6.8	-	-	-	29	-	-	-	30	-	-	-	32	-	-	-	40
015Q-XX	208	10.8	-	-	-	43	-	-	-	50	-	-	-	46	-	-	-	50

Table 1. Electrical Ratings

For 25 kw & 30 kw Heater Kits: Attach the 4-Pin and 3-Pin Harnesses to the Auxiliary circuit board.

**NOTE:** A wiring diagram and a rating label are supplied with the electric heater kit. Affix the wiring diagram to the blower housing.

- When installing the electric heater kit into a standard air handler, affix the supplied rating label over the electrical data section of the air handler unit data label located on the lower access door.
  - When installing the electric heater kit into a variable speed air handler, the rating label supplied with the kit will NOT be used. Check the appropriate block on the air handler ratings label located on the lower access door.
8. Install the circuit breaker bracket inside of the air handler. Position the tab on the bottom of the bracket into the slot of the control panel box. See Figure 2 (page 4) for proper placement of bracket
  9. Slide the bracket forward and align the screw holes with the holes in the bottom of the control panel box. Secure the bracket to the air handler with the supplied screws.

### Electric Heater Kits with Circuit Breakers

**NOTE 1:** Circuit breakers supplied with the H6HK electric heater kit are for short-circuit protection of the internal wiring and to serve as a unit disconnect. They DO NOT provide over-current protection of the supply wiring. Over-current protection of the supply wiring must be provided at the distribution panel and sized as shown in Table 1 (page 4) or the unit data label, and in accordance with the NEC and all applicable local codes.

**NOTE 2:** In some cases, the over-current protection specified in Table 1 (or the unit data label) is less than the 60 amp rating of the circuit breakers used in the H6HK electric heater kit. This difference may occur if the function of the over-current protection required at the distribution panel (field supplied) and the function of the circuit breakers in the H6HK electric heater kit are different.


#### 5, 8, & 10 kw Electric Heater Kits

1. Snap the circuit breaker onto the circuit breaker bracket as shown in Figure 3. The circuit breaker must be positioned (side with 1/4" terminals to the right) as shown in the Figure 2.
2. Remove the lower circuit breaker knockout from the air handler upper access door.

#### 15, 20, 24/25, & 29/30 kw Electric Heater Kits

**NOTE 1:** The heavy red and black supply leads are bundled by circuit with wire ties at the factory. The bundle coming from the top element tier is circuit "A".

**NOTE 2:** The element assembly is right-side-up when the limits are on the right side). The bundle coming from the second element tier is circuit "B". The bundle coming from the bottom element tier is circuit "C".

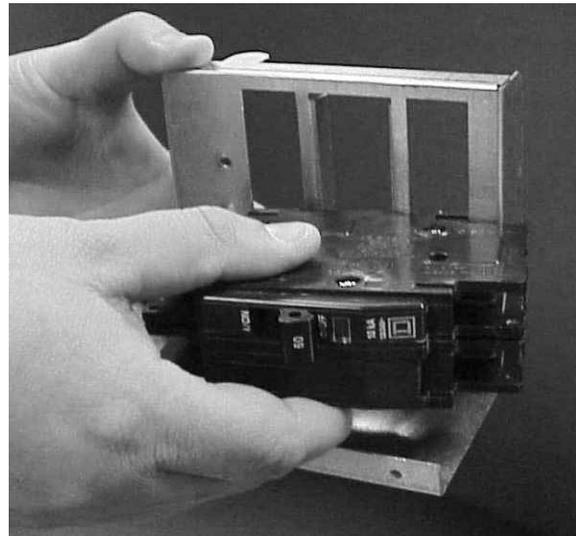

**Figure 3. Installation of Circuit Breakers**

1. Snap the circuit breakers onto the circuit breaker bracket as shown in Figure 3. The circuit breakers must be positioned (side with 1/4" terminals to the right) as shown in the Figure.
2. Remove all necessary circuit breaker knockouts in the air handler upper access door.

#### 3-Phase 9 & 15 kw electric heater kits

1. Snap the 3-pole circuit breaker onto the circuit breaker bracket as shown in Figure 3. The circuit breaker must be positioned (side with 1/4" terminals to the right) as shown in the Figure.
2. Remove all circuit breaker knockouts in the air handler upper access door.

#### Line Cover

Heater Kits with circuit breakers are supplied with a line cover shown in Figure 4 (page 6). The line cover is required by code in order to protect installers from the line/supply wiring. The line cover should be installed as shown in Figure 5.

### Electric Heater Kits without Circuit Breakers

1. Attach the supplied power terminal block to the circuit breaker bracket with the supplied screws as shown in Figure 6 (page 6).
2. Using the 1/4" terminals, connect the red supply wire(s) from the element assembly to one pole of the terminal block and connect the black wires to the other pole.

#### **Staging**

All Single-phase heater kits are internally staged using B5, B6, HMG and HMB air handler circuit board logic. B5 air handlers may stage the heater kit with a slow or fast timed option. B6 single stage air handlers will not stage the heater kit. B6 two-stage air handlers may stage the heat Kw turned on with either a low or high heat call. All 3-phase heater kits are not equipped for internal staging. Refer to the installation instructions supplied with the air handler for additional staging information



Figure 4. Line Cover

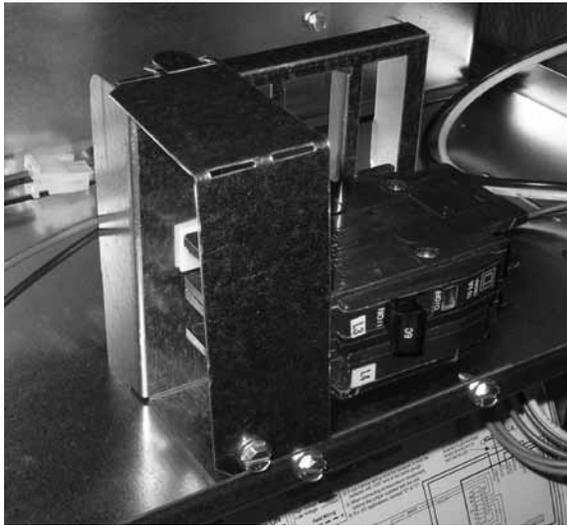


Figure 5. Line Cover Installed

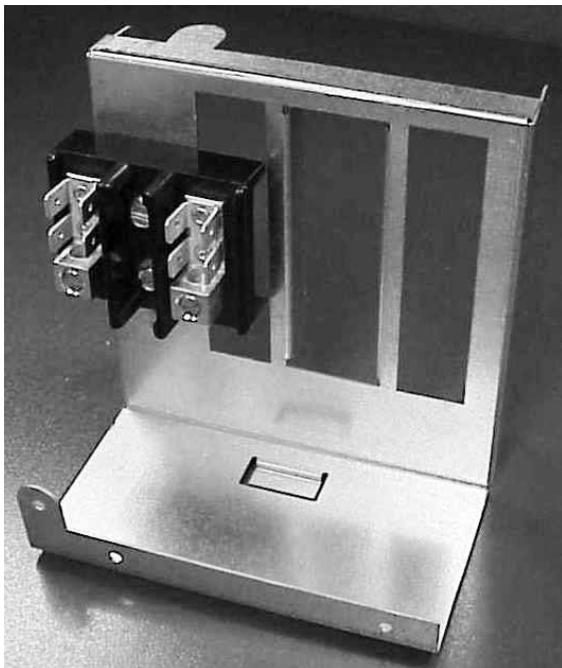


Figure 6. Circuit Breaker Bracket with Terminal Block Installed

### Power Wiring

All wiring must comply with the current revision of the National Electric Code and must be sized for the minimum ampacities as listed on the unit data label or in Table 1. Refer to the detailed wiring diagrams (pages 8 - 14) for proper connections.

If a single circuit adaptor kit is used it may need to be re-configured for some applications. Remove the single circuit adaptor kit cover and verify that the lugs are configured correctly for the application. If the lugs are not configured for the application, reference the instructions included with the kit and modify the configuration. Install the single circuit adaptor kit (if used) in the line side ("on" end) of the circuit breakers. Tighten the lugs securely (45 in-lbs recommended).

Connect the supply wiring to the circuit breaker(s), single circuit adaptor kit, or terminal block. Tighten the lugs securely.

When using multiple supply circuits verify that the supply sized for circuit "A" is connected to the circuit breaker that is connected to the top element assembly.

Install metal circuit breaker line cover on the left side of the circuit breaker to cover the supply wires.

### MOTOR SPEED SELECTION

#### Standard Air Handlers

The blower speed is preset at the factory for operation at the same speed for heating and cooling, by using the blower motor jumpering terminal on the blower motor and connecting it to the desired speed with both the red and black wires connected to the jumpering terminal. For optimum system performance and comfort, it may be necessary to change the factory set speed. To change the blower speed:

---

### WARNING:

---

To avoid the risk of electric shock, personal injury, or death, disconnect all electrical power to the unit before performing any maintenance or service. The unit may have more than one electrical power supply.

---

1. Disconnect all electrical power to the unit and remove the upper door.
2. Remove the black and red wires from the blower motor jumping terminal. Discard the blower motor jumping terminal.
3. Connect the heating speed wire (red) and the cooling speed wire (black) to the desired blower speed marked on the terminal block of the blower motor.

**IMPORTANT:** After changing the blower speed setting, make sure to bundle and insulate any unused blower motor leads so that they will not make contact with the air handler cabinet or non-insulated live parts.

**Standard 3 Speed Motors**

- Terminal 4 = Hi speed
- Terminal 5 = Med speed
- Terminal 6 = Low speed

**Standard C-Cabinets**

- Terminal M1 = Low speed
- Terminal M2 = Medium Low speed
- Terminal M3 = Medium speed
- Terminal M4 = Medium Hi speed
- Terminal M5 = Hi speed.

High speed operation may be required when using a 20, 24/25, & 29/30 kw electric heater kit in a downflow application. Also see Clearances to Combustibles (page 3).

4. Replace the upper door and secure it to the unit.
5. Restore power to the unit.

**Variable Speed Air Handlers**

The minimum electric heat airflow is selected by setting switches on the air handler circuit board. Selecting the minimum electric heat airflow sets the minimum air flow that will be produced whenever electric heater kits are energized. When the electric heater kits are energized along with a heat pump, the airflow may be higher depending on the basic cooling/heat-pump airflow setting. Reference the installation instructions supplied with the air handler for additional airflow information.

Model H6HK-	Cabinet Size			Minimum Required Blower Heating Speed		
	A	B	C	UpFlow	Horizontal	Downflow
005H	X	X	X	LOW	LOW	LOW
008H	X	X	X	LOW	LOW	LOW
010H	X	X	X	LOW	LOW	LOW
015H	X	X	X	LOW	LOW	MED
020H		X	X	LOW	LOW	HIGH
024H / 025H		X	X	MED	MED	HIGH
029H / 030H			X	MED	MED	N/A
009Q		X	X	LOW	LOW	LOW
015Q		X	X	LOW	LOW	MED

(1) Only on \*30 (2.5 Ton) model air handlers

**Table 2. Blower Heating Speed**

Model	Cabinet Size
H(M,C)G024	A
H(M,C)G030	A
H(M,C)G036	B
H(M,C)G042	B
H(M,C)G048	C
H(M,C)G060	C

**Table 3. HMG Cabinet Sizes**

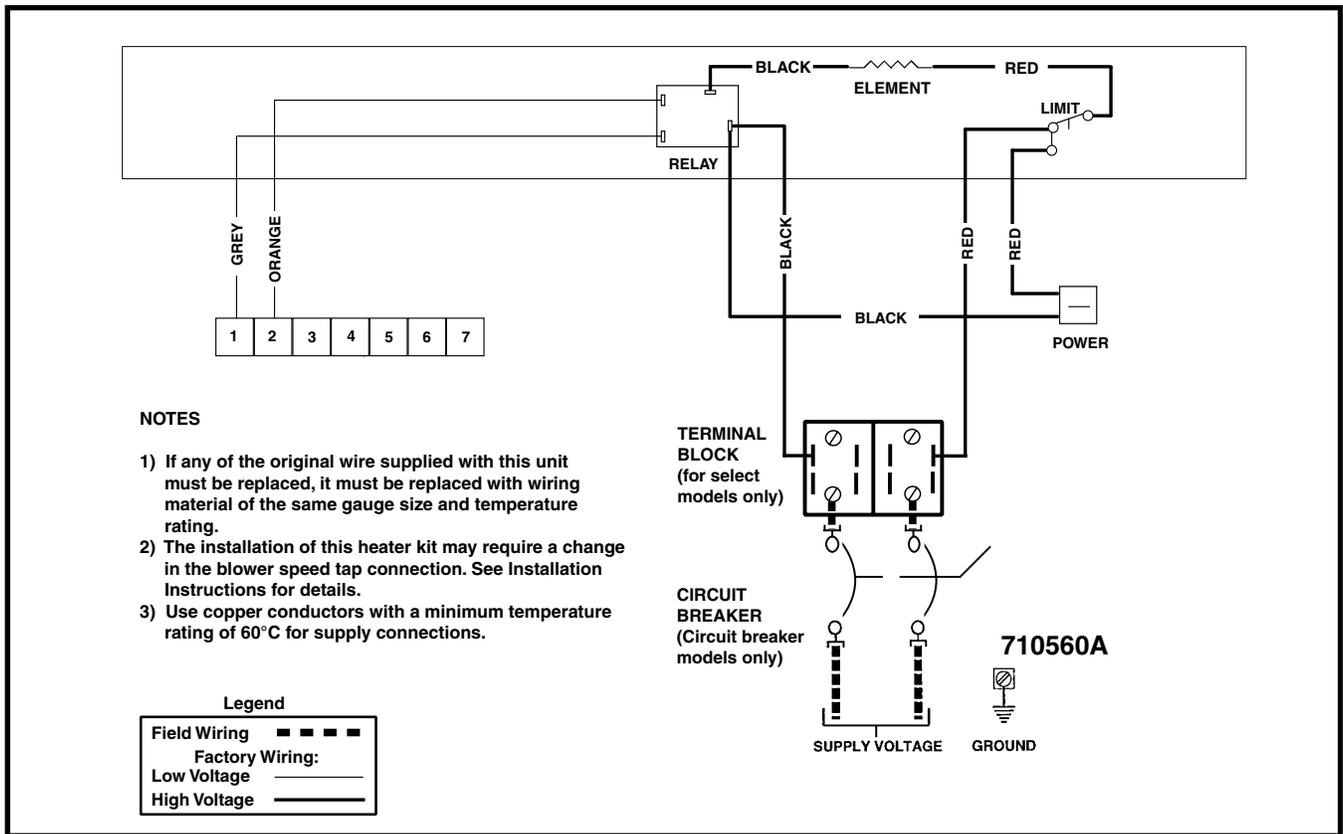


Figure 7. Wiring Diagram for H6HK Single Stage Air Handler with Circuit Breaker(s) - 5 kw Series

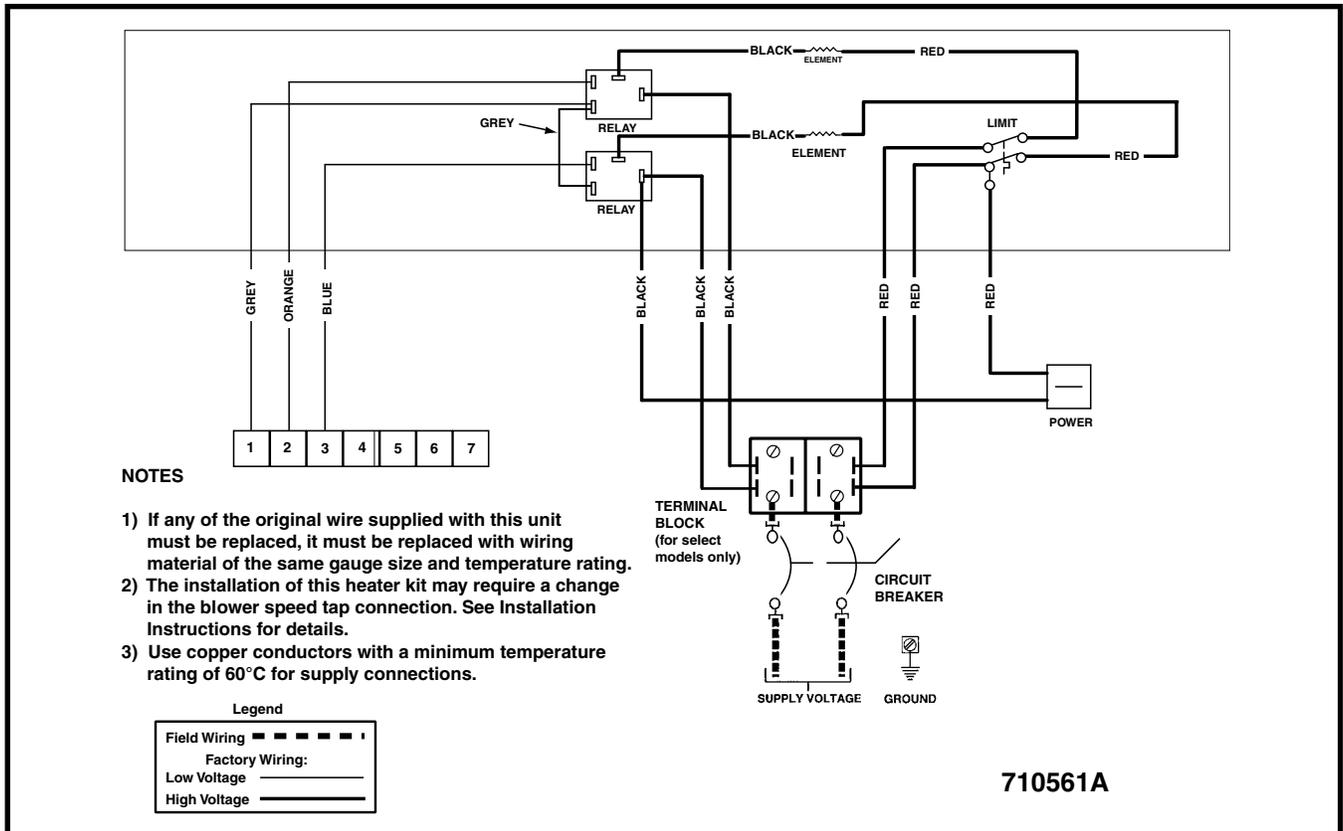


Figure 8. Wiring Diagram for H6HK Single Stage Air Handler with Circuit Breaker(s) - 8/10 kw Series

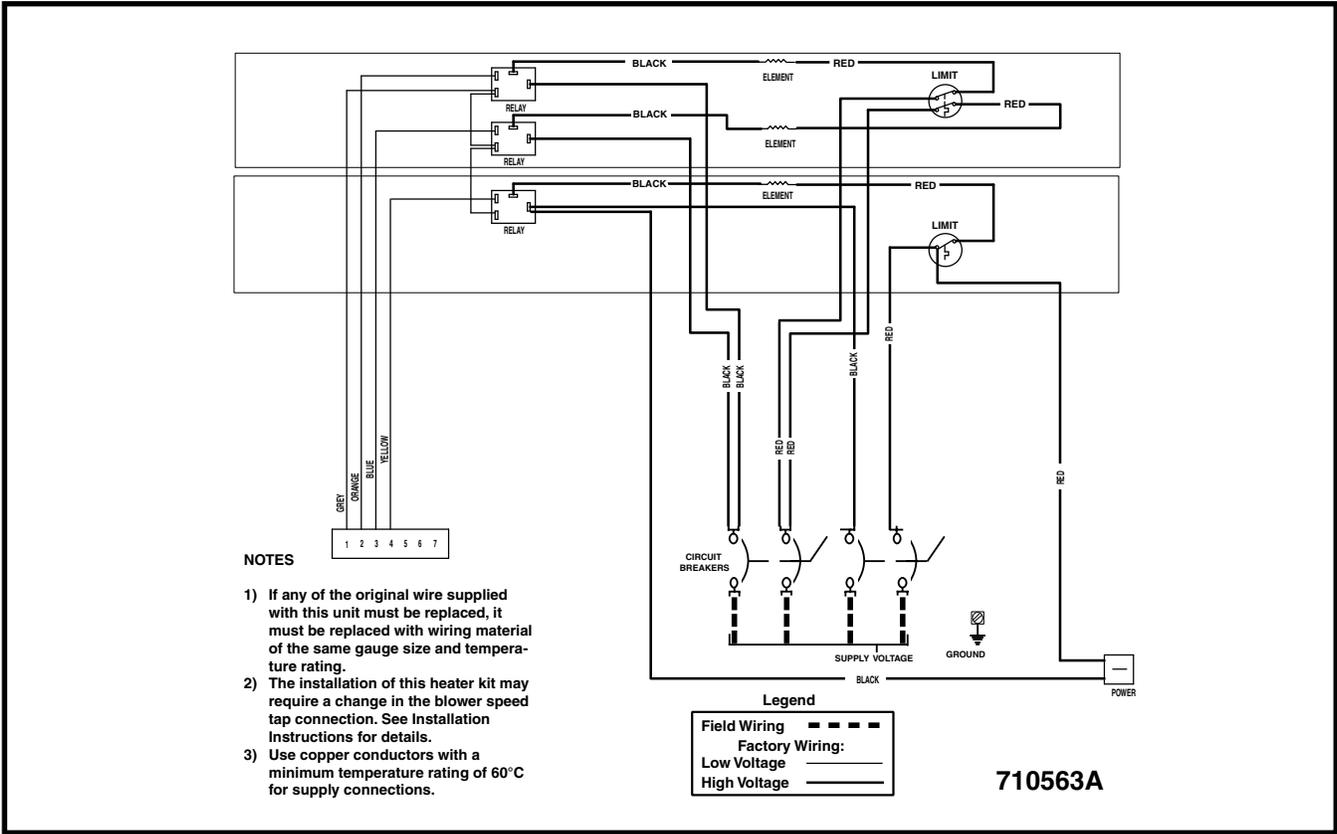


Figure 9. Wiring Diagram for H6HK Single Stage Air Handler with Circuit Breaker(s) - 15 kw Series


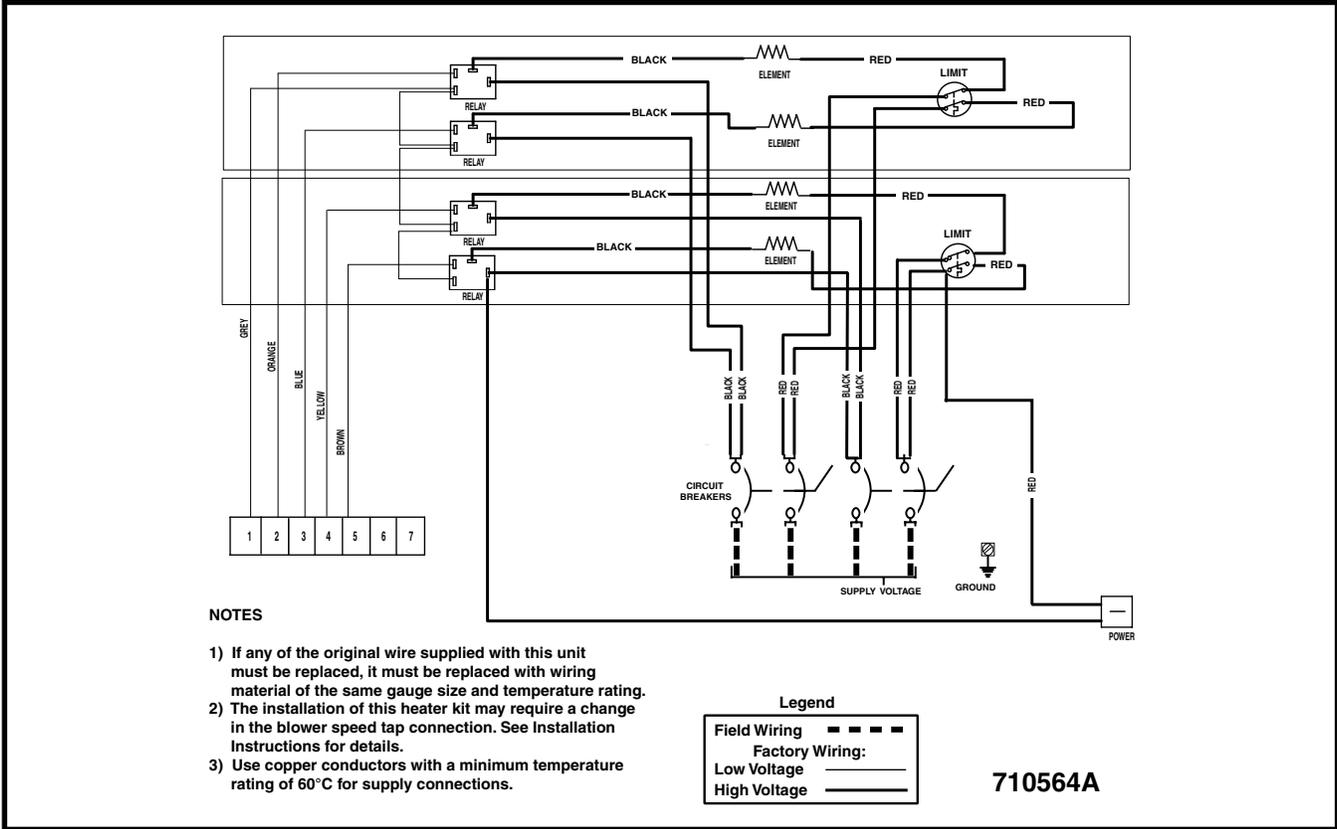


Figure 10. Wiring Diagram for H6HK Single Stage Air Handler with Circuit Breaker(s) - 20 kw Series

# WIRING DIAGRAM

H6HK024H-31 (with circuit breaker)

25kW, 240 VAC, 1-Phase Electric Heater Kit

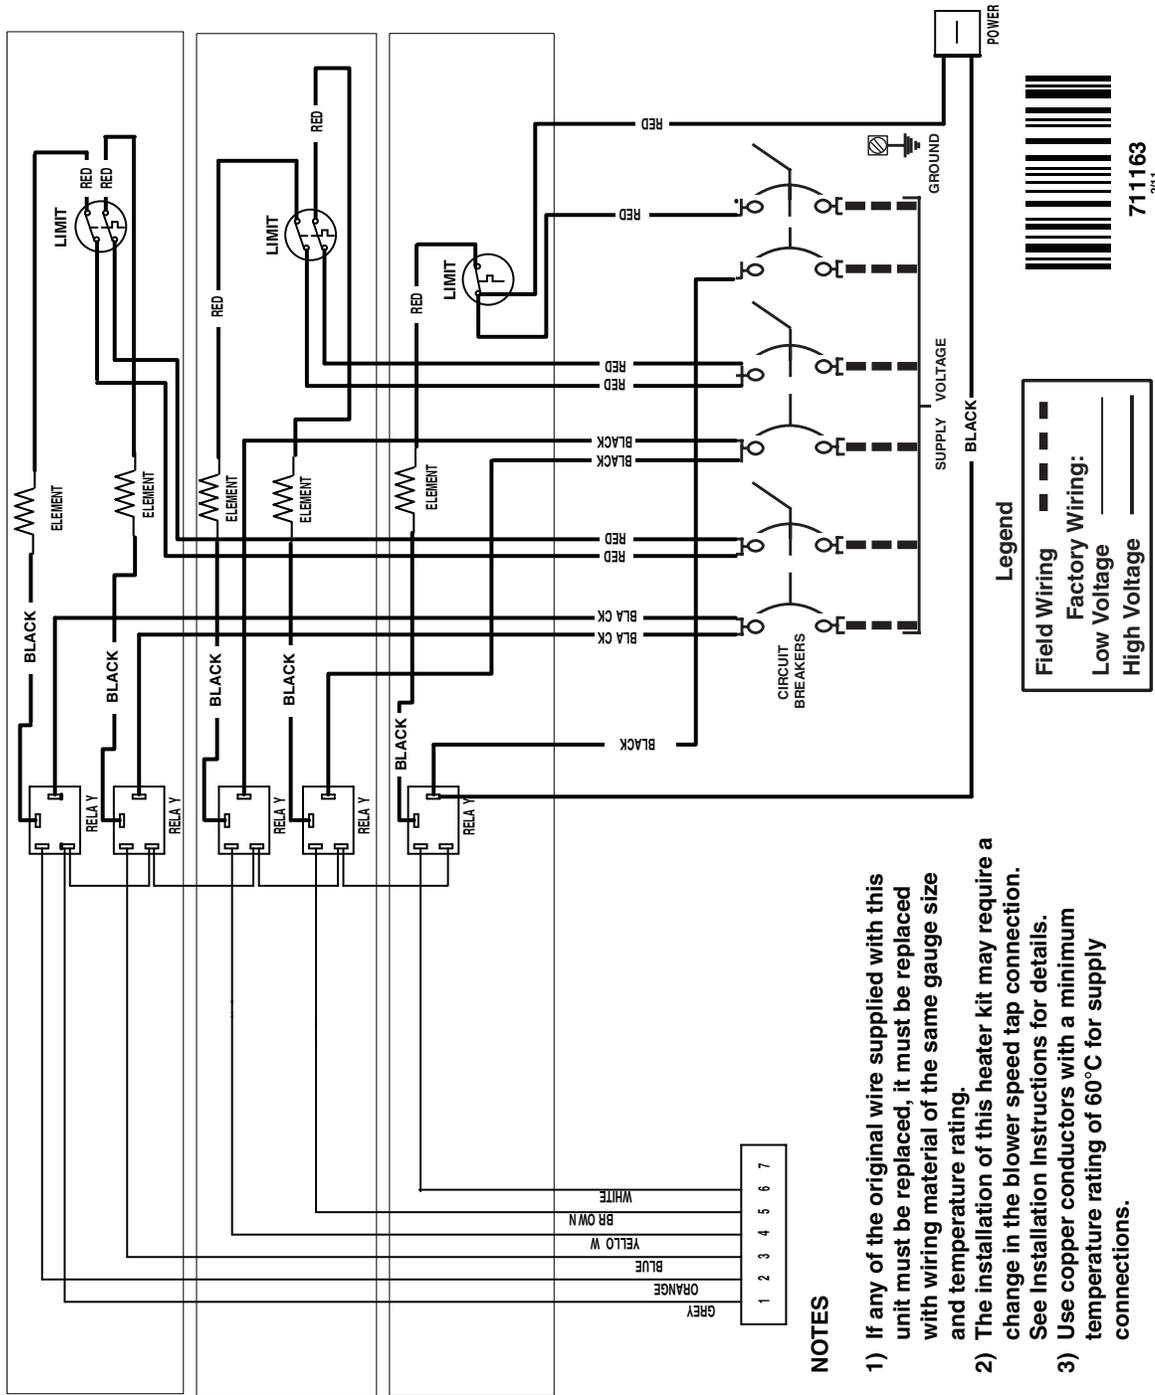

## NOTES


- 1) If any of the original wire supplied with this unit must be replaced, it must be replaced with wiring material of the same gauge size and temperature rating.
- 2) The installation of this heater kit may require a change in the blower speed tap connection. See Installation Instructions for details.
- 3) Use copper conductors with a minimum temperature rating of 60°C for supply connections.



711163  
2/11

## Legend

- Field Wiring (dashed line)
- Factory Wiring (solid line)
- Low Voltage (thin line)
- High Voltage (thick line)

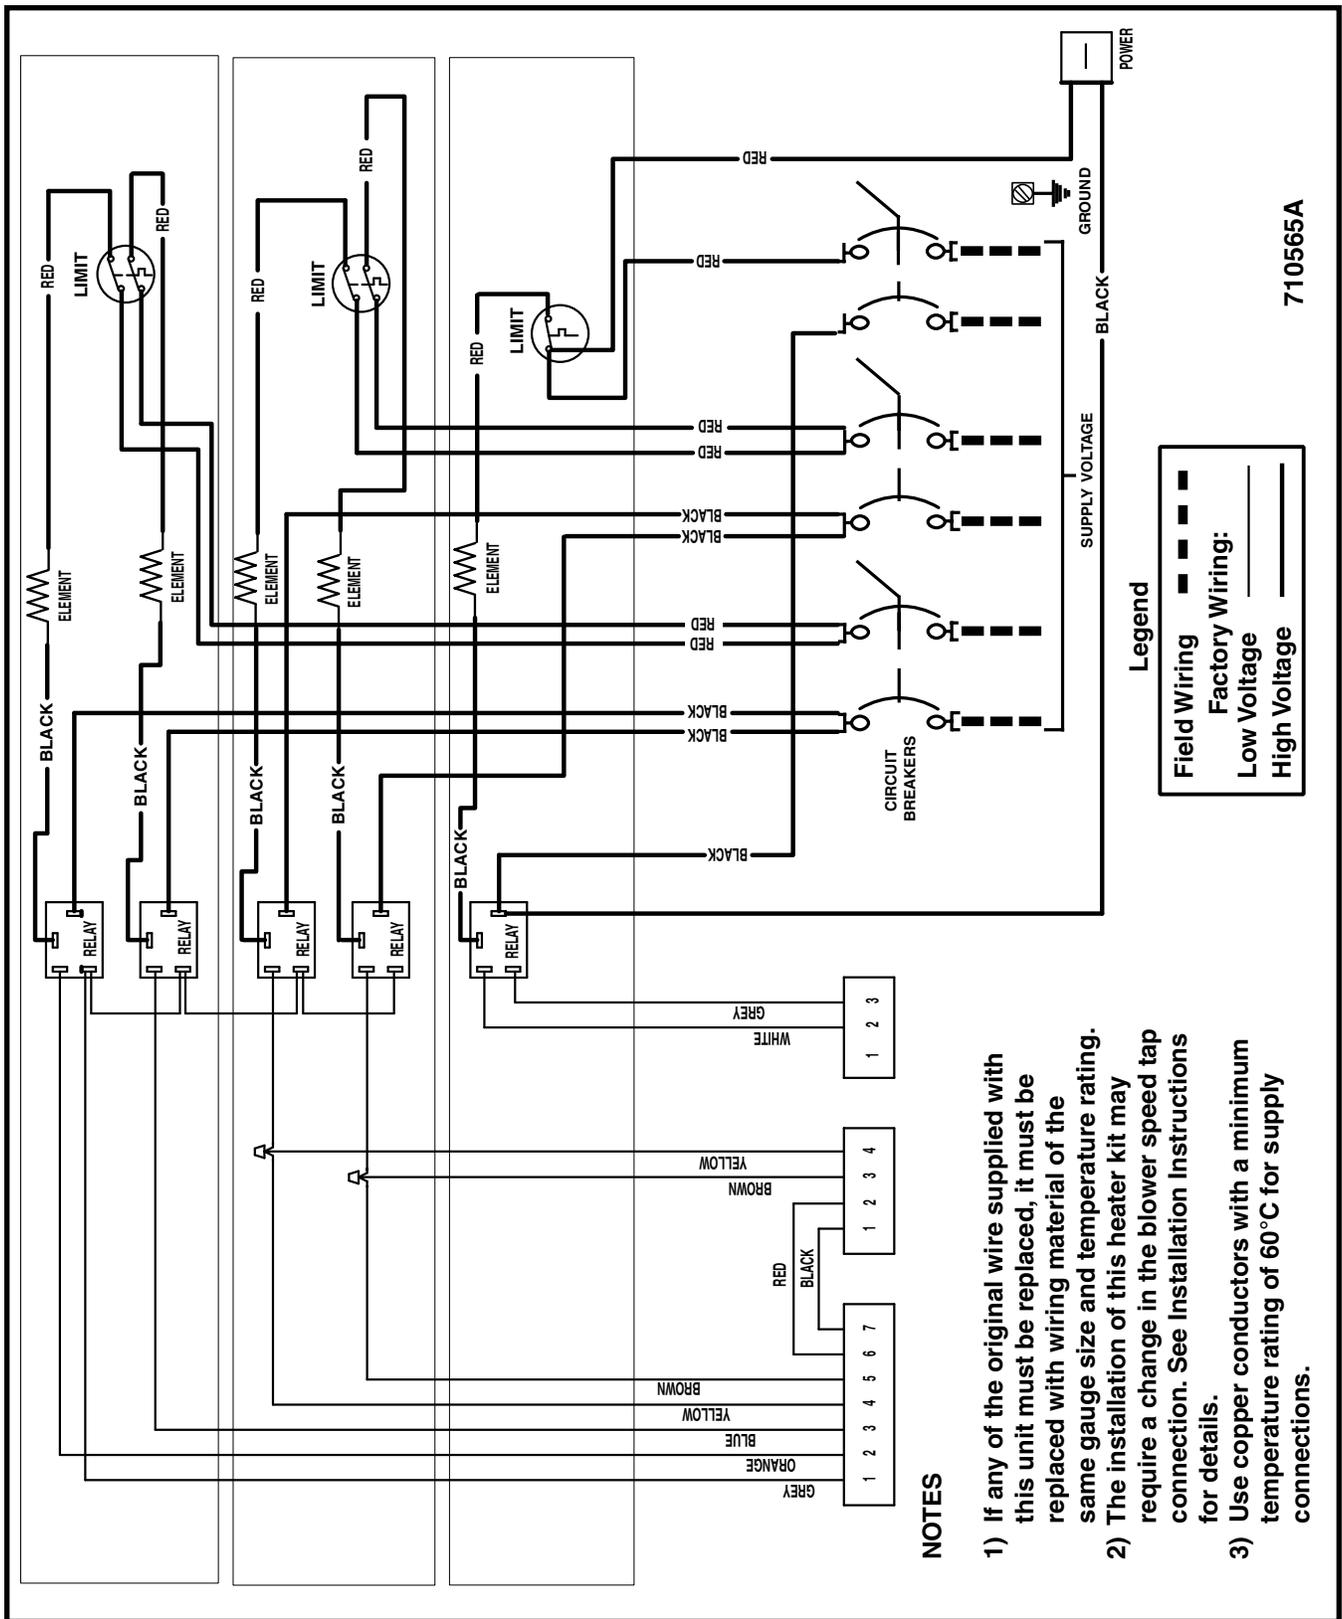


710565A

Figure 12. Wiring Diagram for H6HK Single Stage Air Handler with Circuit Breaker(s) - 25 kw Series

# WIRING DIAGRAM


H6HK029H-31 (with circuit breaker)

30kW, 240 VAC, 1-Phase Electric Heater Kit

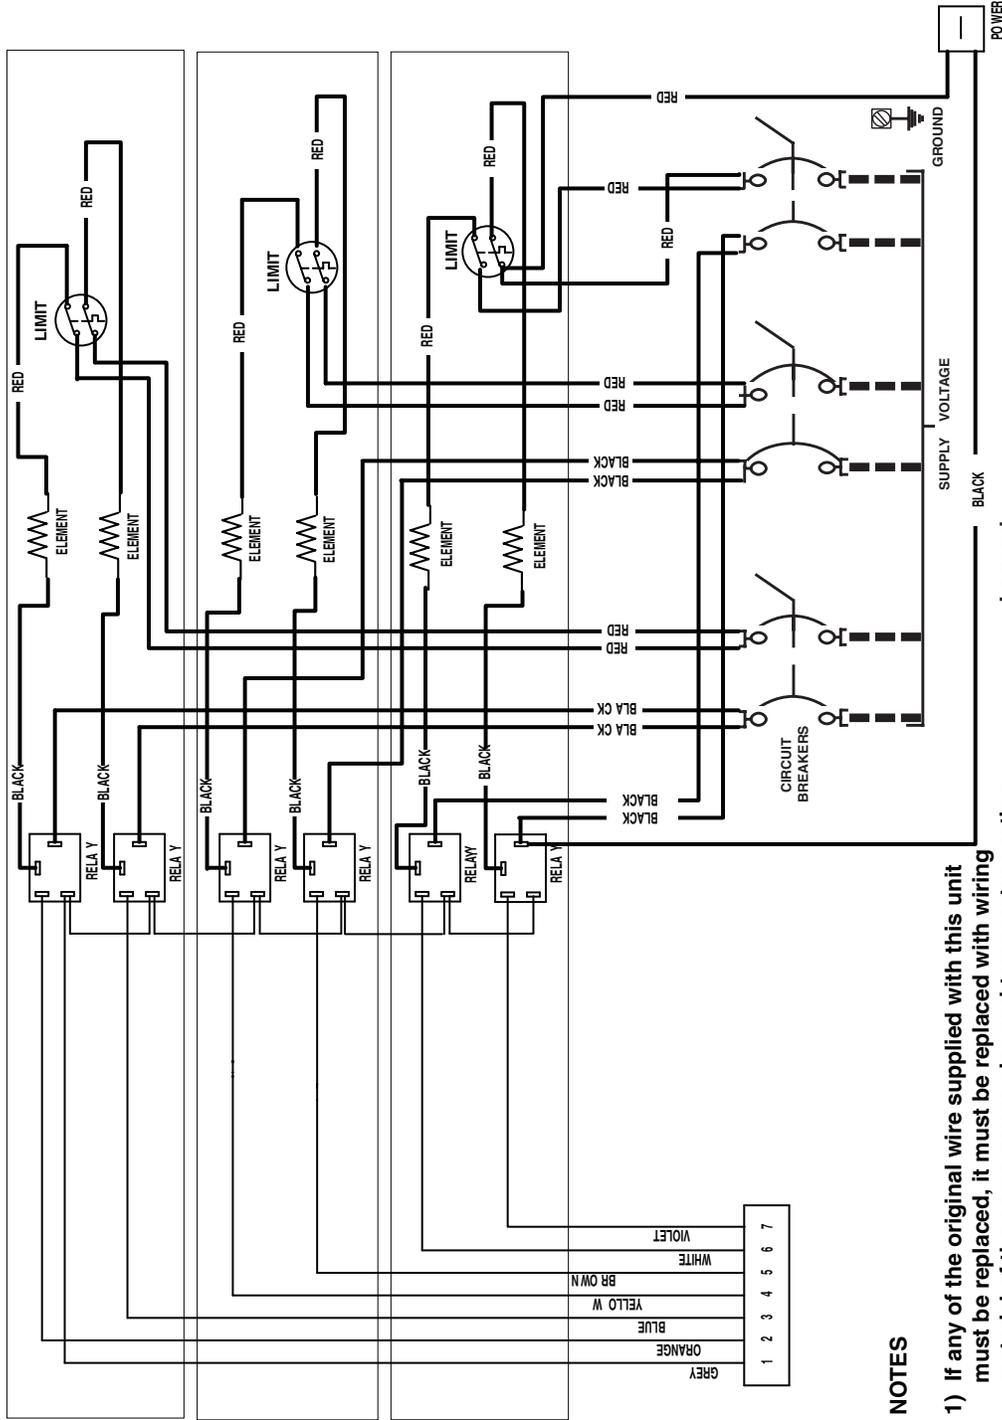


## NOTES

- 1) If any of the original wire supplied with this unit must be replaced, it must be replaced with wiring material of the same gauge size and temperature rating.
- 2) The installation of this heater kit may require a change in the blower speed tap connection. See Installation Instructions for details.
- 3) Use copper conductors with a minimum temperature rating of 60°C for supply connections.

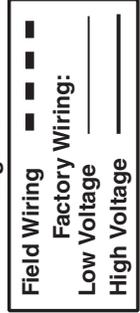


711164  
2/11

Figure 13. Wiring Diagram for H6HK Single Stage Air Handler with Circuit Breaker(s) - 29 kw Series

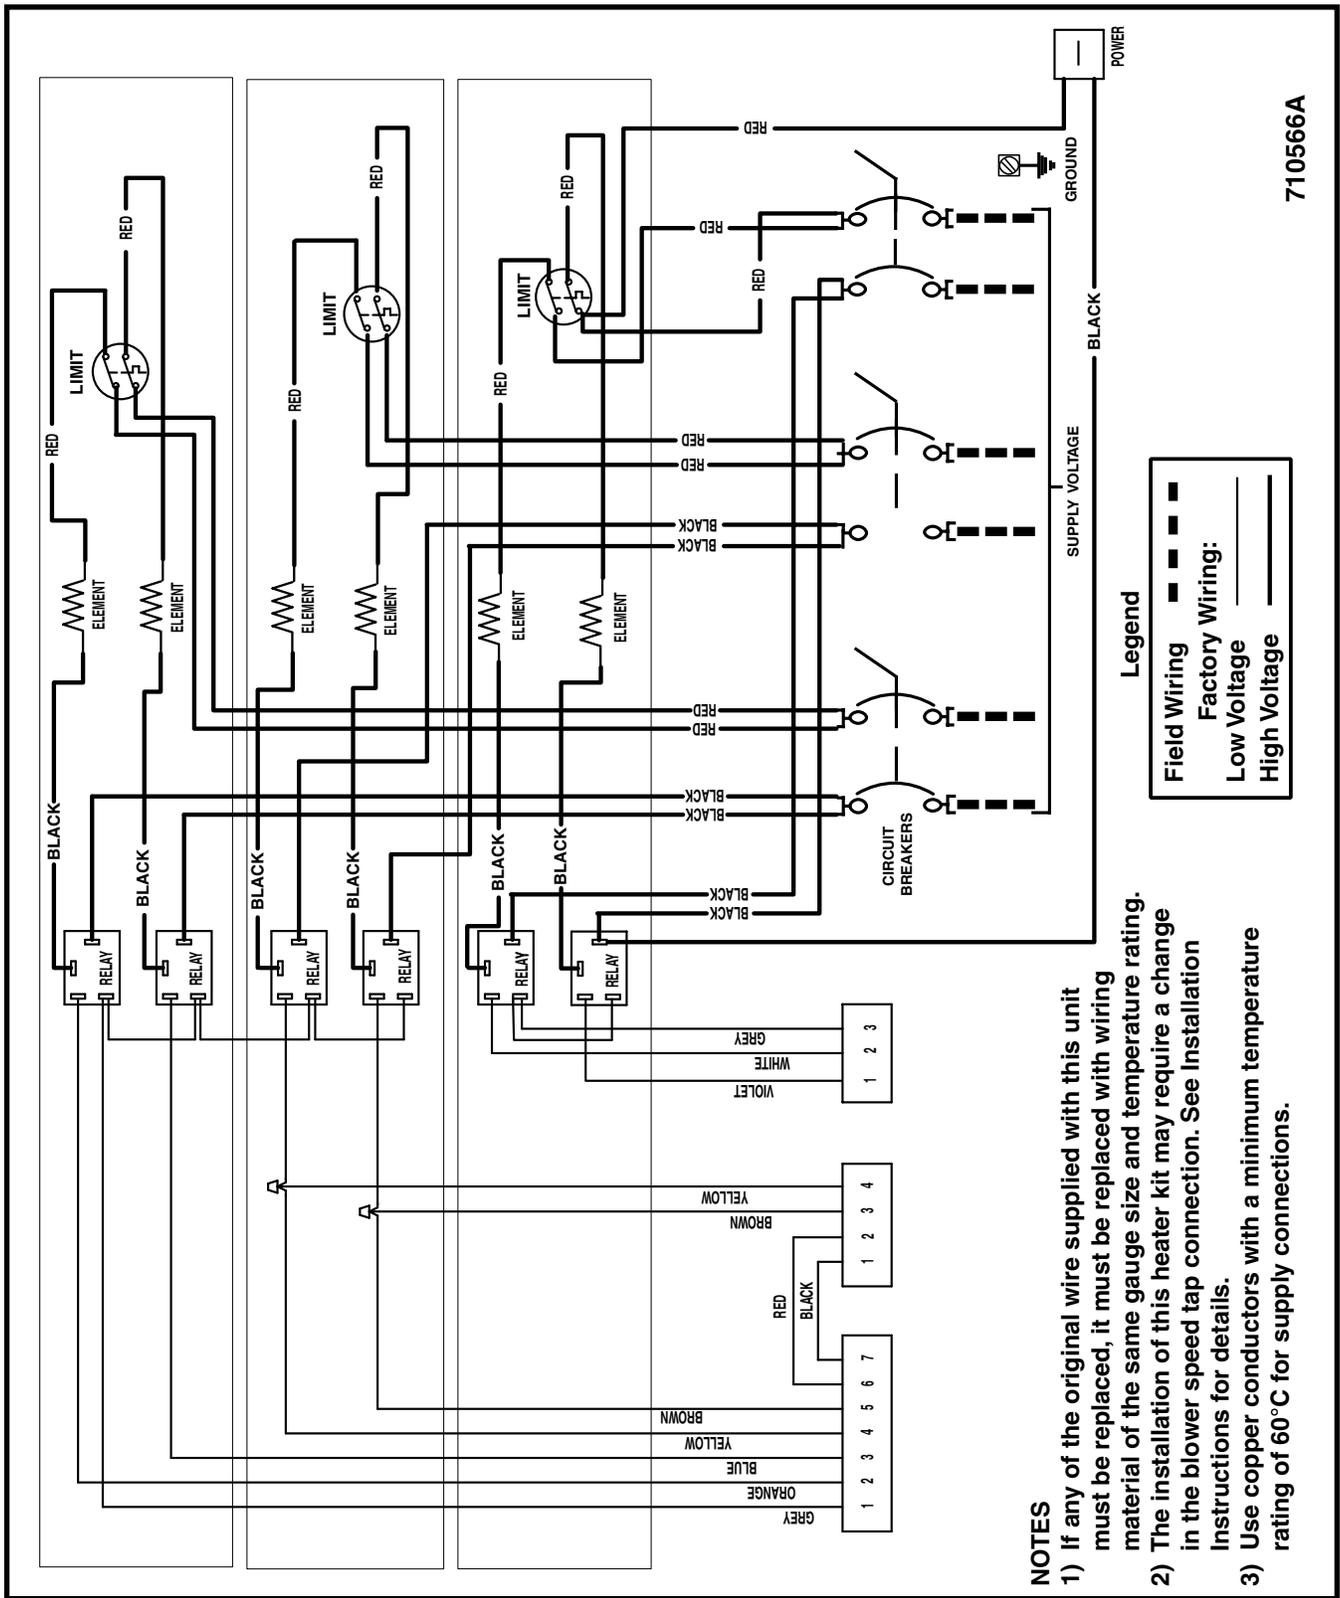

710566A

Figure 14. Wiring Diagram for H6HK Single Stage Air Handler with Circuit Breaker(s) - 30 kw Series

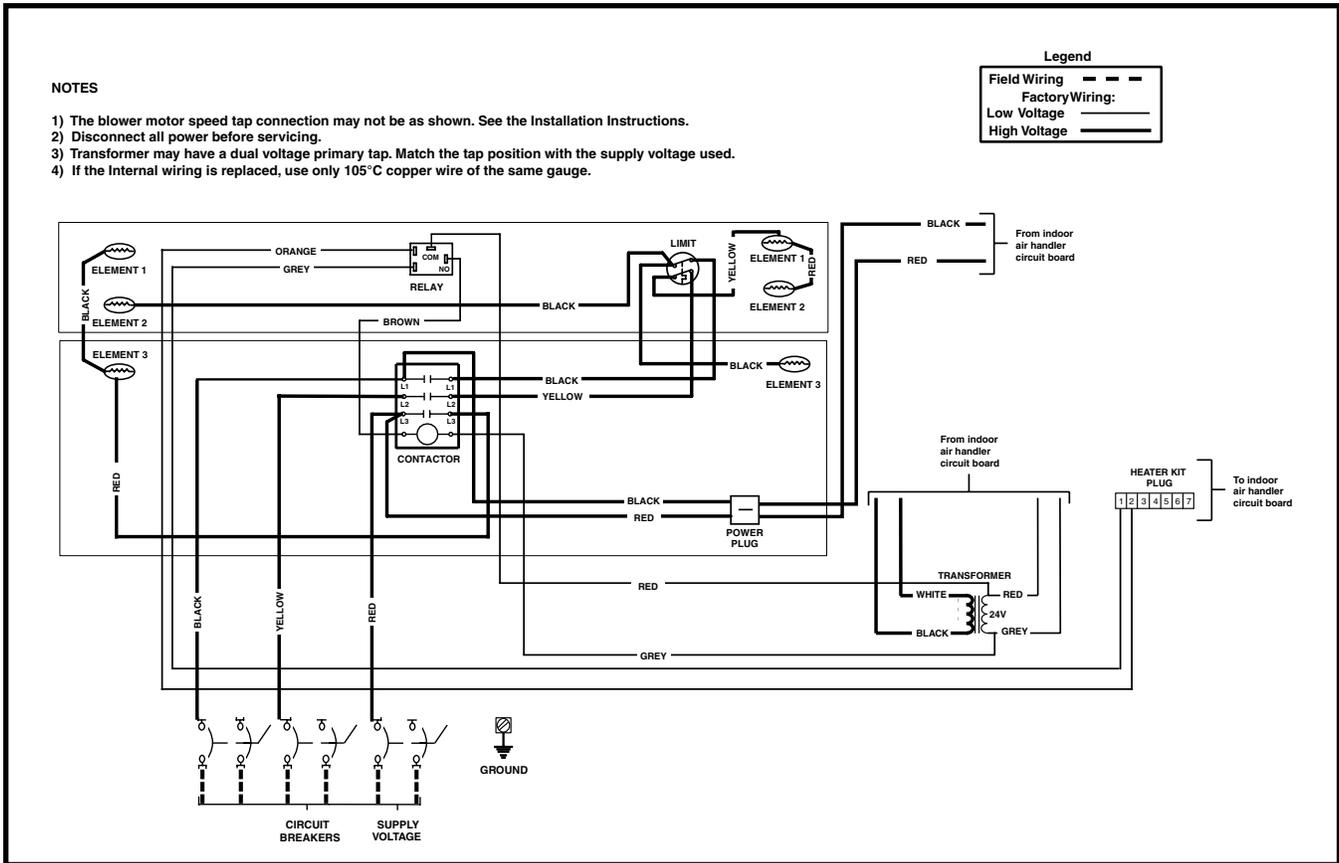

**Figure 15. H6HK Wiring Diagram for 3-Phase Electric Heater Kit - 9kw & 15kw Series**



**INSTALLER: PLEASE LEAVE THESE INSTALLATION  
INSTRUCTIONS WITH THE HOMEOWNER**

