


# WIRING DIAGRAM

**NOTES:**

1. If any of the original wire supplied with this unit must be replaced, it must be replaced with wiring material of the same gauge size and temperature rating.
2. The installation of this heater kit may require a change in the blower speed tap connection. See Installation Instructions for details.
3. Use copper conductors with a minimum temperature rating of 60°C for supply connections.

H8HK005H-01  
H8HK005H-11

3 kW, 5 kW, 1-Phase Electric Heater Kit

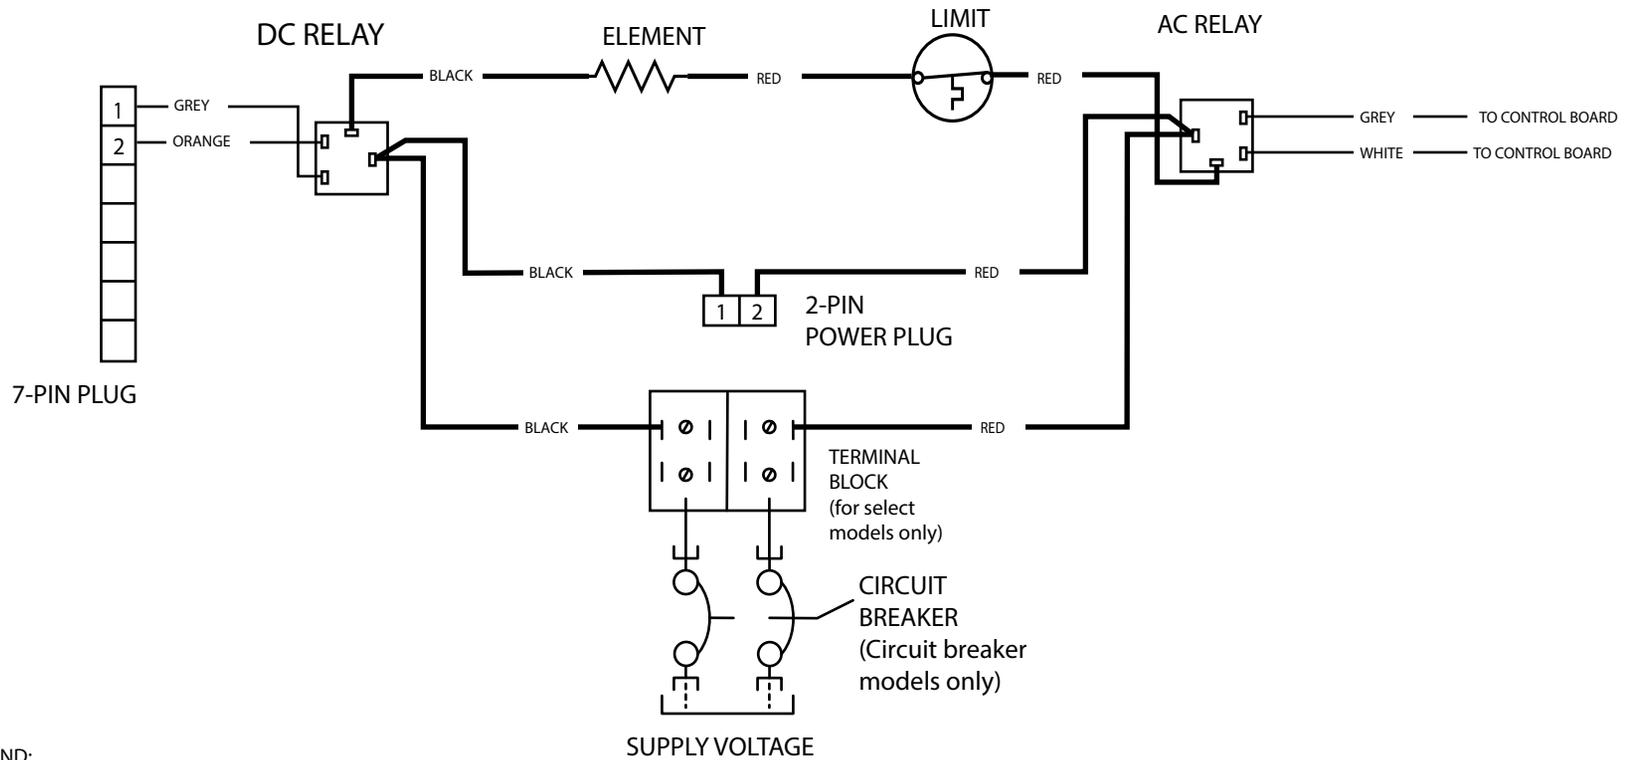

**LEGEND:**

FIELD WIRING	----
LOW VOLTAGE	— — — —
HIGH VOLTAGE	————



711433B  
(Replaces 711433A)

05/15